

# Liquid Trade Waste

## Category 2 Classification B - Motor Trades



### Definition

**Liquid trade waste (LTW)** is any discharge to a sewerage system other than domestic waste from a hand wash basin, shower, bath or toilet.

**Central Coast Council** is referred to as Council.

### Introduction

This Fact Sheet is provided to assist you to treat and dispose of liquid trade waste in an efficient and approved manner.

For further information, please contact Council's Trade Waste Section on 4306 7900. For LTW application forms, refer to [www.centralcoast.nsw.gov.au](http://www.centralcoast.nsw.gov.au).

### Activities

Mechanical repair activities include the following facilities:

- A stand-alone garage
- A stand-alone mechanical workshop
- A service station workshop
- Lawnmower repairers that conduct mechanical repairs only and no other processes
- Motor boat repairers that conduct mechanical repairs only and no other processes
- Pre-treatment
- A collection well and non-emulsifying pump must be provided to collect:
- Water used for washing of mechanical equipment or parts
- Floor wash down

### What pre-treatment is required?


The installation required to treat the waste water is a coalescing plate interceptor (CPI/CPS) with a minimum capacity of a 1000 L/h or a vertical gravity separator (VGS) or hydrocyclone separation system (HSS) sized according to the influent flow rate. If your flow rate exceeds 1000 L/h, you will require a larger capacity and must provide supporting information regarding sizing and recommended maintenance schedule.

Make sure the unit is correctly installed, and where applicable the distributor or supplier must be able to guarantee supply of parts and service maintenance.

- Fit a basket arrestor or screen to all floor wastes that drain to the sewerage system, to strain out gross solids such as rags and packaging.
- If you cannot avoid using detergents, use only quick-break detergents, as oil arrestors are more efficient if detergents are not used.
- Clean using high water pressure where possible.
- Use only non-emulsifying pumps to pump the liquid waste to the separator.
- Do not discharge degreaser into the sewerage system.

**NOTE:** Double and triple interceptor pits and general purpose pits are not approved or appropriate pre-treatment equipment units for this type of wastewater.




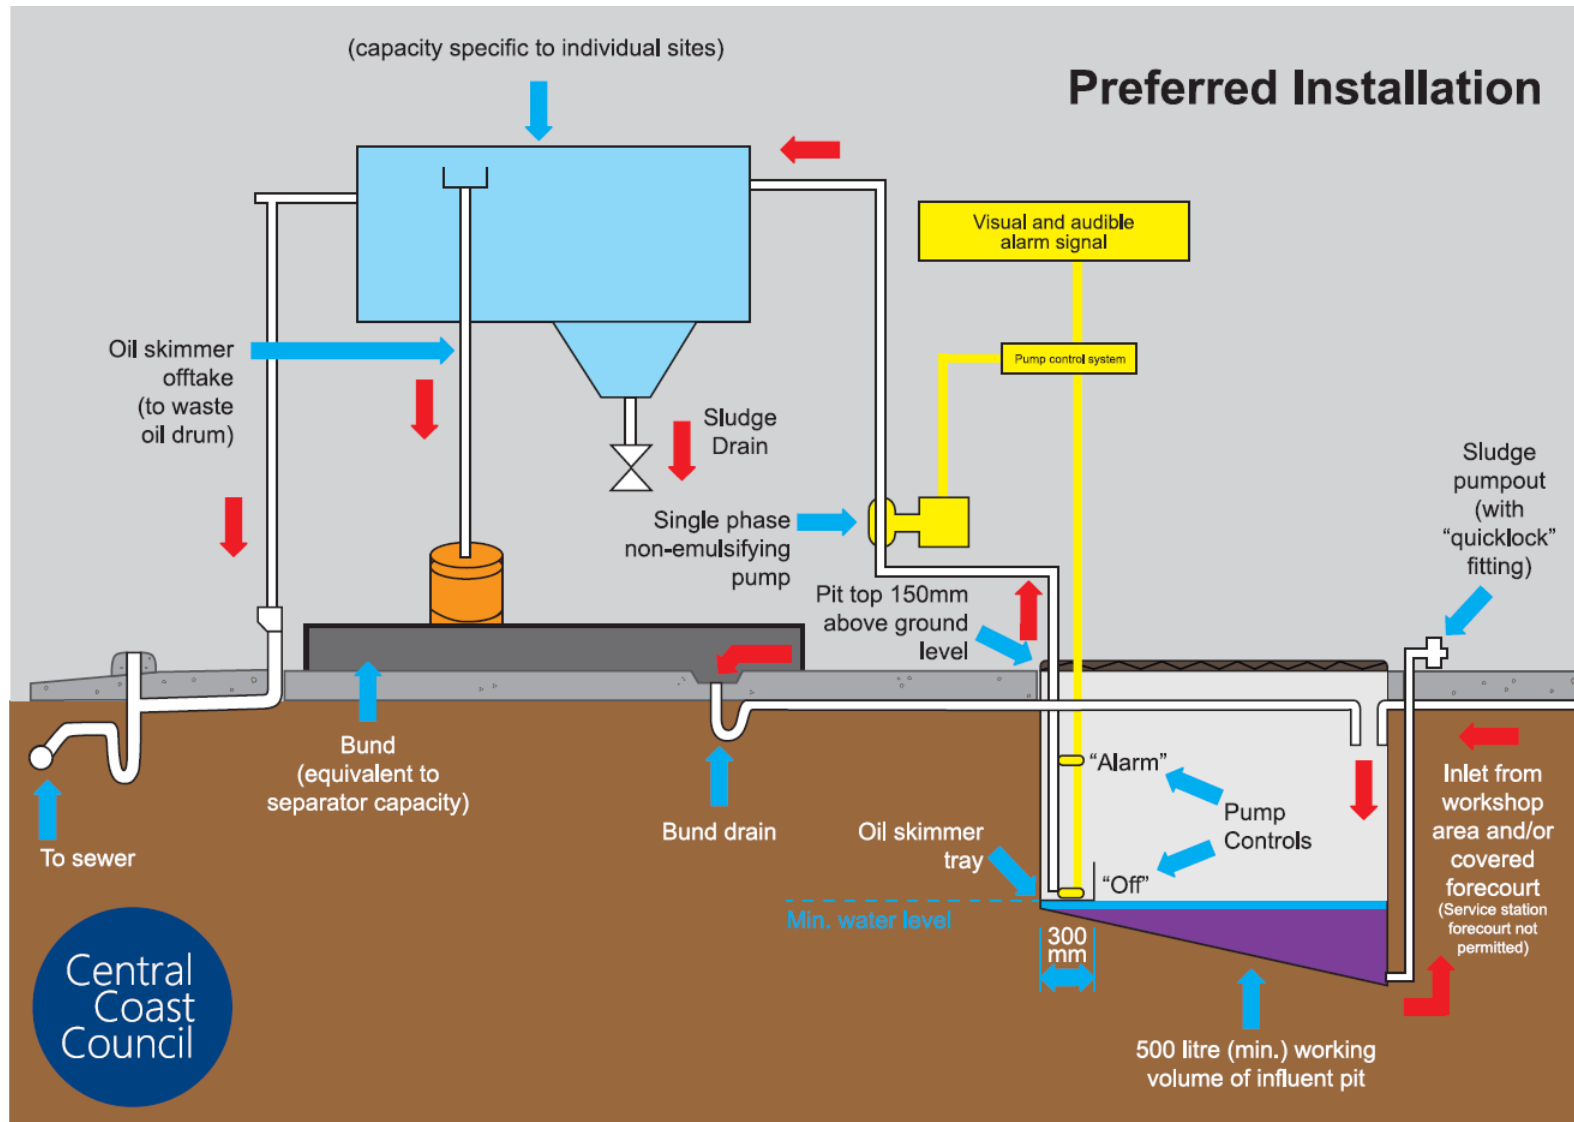

## Coalescing Plate Interceptor (CPI)

Note:

This is an oily water separator. All waste oils and coolants should be disposed via a licenced contractor and not put through the Coalescing Plate Interceptor (CPI) or discharged to sewer.

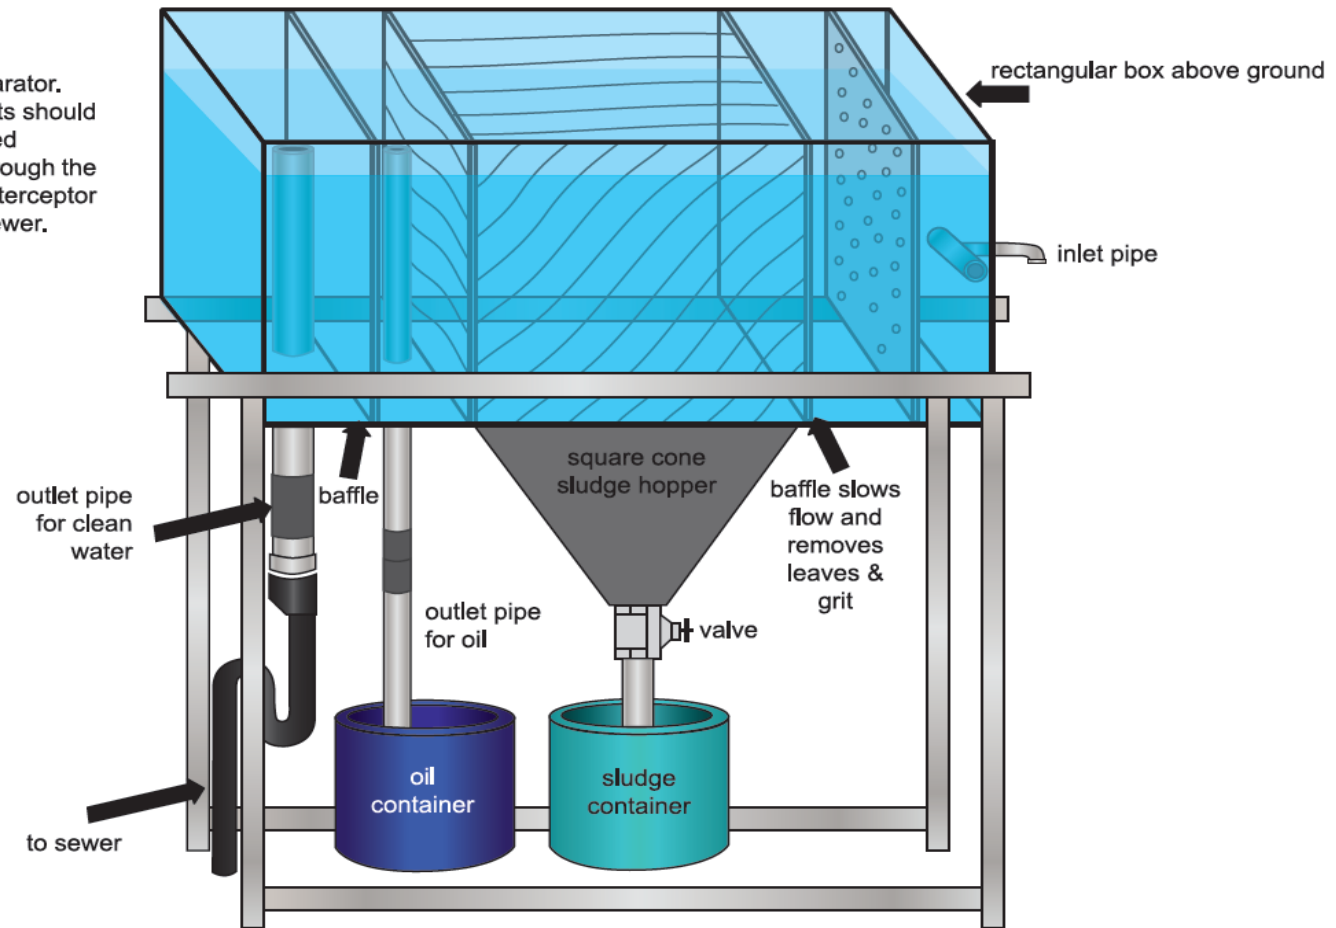

## Stormwater

The wash area must be roofed to exclude rainwater from the sewerage system.

Make sure stormwater is diverted away from the wash area(s).

## Housekeeping practices

- If you cannot avoid using detergents, use only quick-break detergents, to assist the separation process where any type of oil arrestor is used as pre-treatment
- Dry clean oil spills prior to wash down
- Scrape up grease blobs before wash down
- Consider using screens to exclude nuts, washers and the like from the pump intake
- Use only cleaning compounds that are compatible with the pre-treatment system
- Store oils, chemicals and solvents in a separate bunded area that cannot drain to the sewerage or stormwater systems

- Do not discharge petrol, diesel fuel, discrete oil, kerosene, solvents or any other flammable and/or explosive substances into the sewerage or stormwater system


## Plumbing requirements

All plumbing should be installed as per Australian Standards AS/NZS 3500.2:2003 Plumbing and drainage – Sanitary plumbing and drainage.

For public health reasons, install all suitable backflow protection measures (or Mains Containment Protection) on the incoming water supply to the property. Such measures must be a Reduced Pressure Zone Device. Zone protection for prevention of backflow is recommended. The backflow protection measures must be approved and registered with Council.



## Typical installation of Backflow Prevention Device

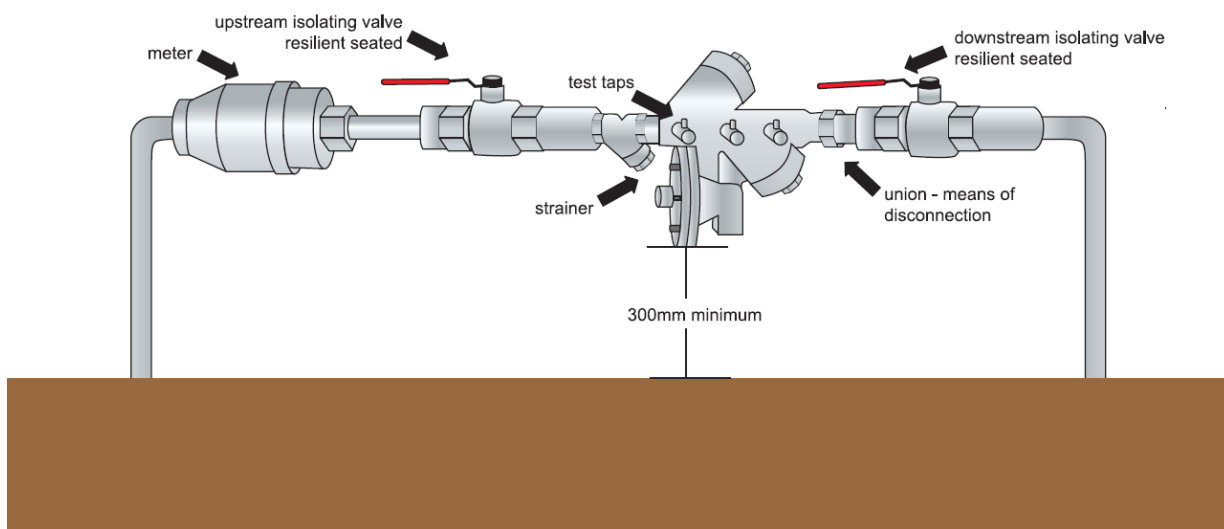



## Business types

Activity	Characteristics of waste	Minimum Pre-Treatment Required
<ul style="list-style-type: none"> <li>Auto dismantler</li> <li>Bus/Coach depot wash bay area</li> <li>Car detailing</li> <li>Mechanical workshop</li> <li>Service stations (workshop only)</li> <li>Vehicle washing (commercial-manual cleaning)</li> <li>Vehicle washing (automatic robots) self service</li> <li>Vehicle washing (including engine degreasing)</li> </ul>	<p>Oil, Grease, Suspended Solids, Petroleum Hydrocarbons, Metals, Solvents, Detergents</p> <p>Kerosene</p>	<p>Basket arrestor. Collection pit minimum capacity 300L. An oil interceptor/separator, sized accordingly.*</p> <p>Kerosene and solvents, if used, are <b>not</b> permitted into the sewer</p> <p>Reuse of wash water</p>
<ul style="list-style-type: none"> <li>Engine/gearbox reconditioning parts washing</li> </ul>	<p>Oil, Grease, Suspended Solids, Detergent, Kerosene, Lead</p>	<p>Basket arrestor. Collection pit minimum capacity 300L. An oil interceptor/separator, sized accordingly.*</p> <p>Kerosene is <b>not</b> permitted into sewer. Acid cracking, pH correction facility may be required.</p>
<ul style="list-style-type: none"> <li>Panel beater/spray painting</li> </ul>	<p>Oil, Grease, Suspended Solids</p>	<p>Basket arrestor. Collection pit minimum capacity 300L. An oil interceptor/separator, sized accordingly.*</p> <p>Discharge from a spray booth area is <b>not</b> permitted. Paint solvents, thinners are <b>not</b> permitted into the sewer.</p>



Activity	Characteristics of waste	Minimum Pre-Treatment Required
<ul style="list-style-type: none"> <li>Radiator repair</li> </ul>	Suspended Solids, pH, Metal	<p>Solids settlement pit. Metal removal and pH adjustment may be required before discharge to sewer.</p> <ol style="list-style-type: none"> <li>Capture the radiator fluid in a tray or container before removing the radiator from the vehicle. Where possible, re-use radiator fluid, otherwise capture and store it for off-site removal by an EPA licenced contractor.</li> <li>Floor must be bunded to prevent spillage draining to sewer.</li> </ol>
<ul style="list-style-type: none"> <li>Service station covered forecourt</li> <li>Bus/Coach depot refuelling bay</li> </ul>	Exempt	Refer to Department of Industry Water, Water Circulation No. LWU13

\*An oil interceptor/separator should be of an approved type such as a coalescing plate interceptor, a vertical gravity separator or hydrocyclone separation system sized accordingly to the influent flow rate. Nominal size is 1000 L/h. Only "quick-Break" detergents should be used. Refer to separate documents for installation requirements and other information on this equipment.

Wash area must be roofed, bunded and graded to exclude stormwater.



## Application to Discharge Liquid Trade Wastes into Council's Sewerage System

CATEGORY 2 – Classification B – Motor Trades			
Date:	Fee Paid \$	Licence No:	Debtor:

**For further enquiries on the application process, please contact Customer Service 02 4306 7900.**

Business Trading Name			ABN:	
Development Application No.	Lot No.	D.P.	Parcel No.	Unit/House No.
Street		Suburb		Postcode
Approval Holder: <i>(The nominated Approval Holder is responsible for operating in accordance with the Trade Waste approval terms and conditions)</i>			Telephone No.	
			Email	
Approval Holder's Address:				

### Approval Holders:

Anyone can apply for approval but if the approval holder is not the owner of the land, then the owner's written consent to lodge the application is required. All correspondence and notice of determination will be sent to the approval holder. It is important to notify Council of any change of address and/or telephone number if this occurs during the processing of the application. By signing this application, you are acknowledging that you have read the notes and instructions on this form and the accompanying checklist, and have included all the requested information as it applies to this application

### Principal Business Activity

Please supply a brief statement of the business type and processes generating liquid trade waste e.g. laundry, animal wash, dentistry etc

Any water supply meter being installed? <input type="checkbox"/> Yes <input type="checkbox"/> No	Existing water meter number	Meter location
---	-----------------------------	----------------

### EXISTING / PROPOSED EQUIPMENT (GREASE ARRESTOR, BASKET ARRESTOR, COOLING PIT, DILUTION PIT, CPI, VGS, ETC)

Type	Size/flow rate
------	----------------

### PROPOSED CLEANING SCHEDULE OF PRE-TREATMENT EQUIPMENT AND NAMES OF CONTRACTORS USED

Pre-treatment equipment		Frequency (weeks)
Name of Contractor		Contact number
Location of pre-treatment device (sample point if required, CPI, VGS)		
Refer to Council's <a href="#">Liquid Trade Waste Policy</a> for the Liquid Trade Waste Quality Standards, which lists pollutants and their allowable limits		



#### SUBSTANCES PROHIBITED FROM BEING DISCHARGED TO THE SEWERAGE SYSTEM

The following substances are prohibited from being discharged to the sewerage system:

- organochlorine weedicides, fungicides, pesticides, herbicides and substances of a similar nature and/or wastes arising from the preparation of these substances
- organophosphorus pesticides and/or waste arising from the preparation of these substances
- any substances liable to produce noxious or poisonous vapours in the sewerage system
- organic solvents and mineral oil
- any flammable or explosive substances
- discharges from 'Bulk Fuel Depots'
- chromate from cooling towers
- natural or synthetic resins, plastic monomers, synthetic adhesives, rubber and plastic emulsions
- rain, surface, seepage or subsoil water, unless specifically permitted
- solid matter
- any substance assessed as not suitable to be discharged to the sewerage system
- waste liquids that contain pollutants at concentrations which inhibit the sewage treatment process – refer *National Wastewater Source Management Guideline, July 2008, WSAA*
- any other substances listed in a relevant regulation.

#### CHECKLIST FOR APPLICATIONS

1. Completed application with owner's signature ☐
2. Two copies of plans showing: **(not required for renewals)** ☐
  - Details and location of all processes, tanks, pits and apparatus associated with the generation of commercial waste
  - Details, location, capacity / dimensions, material of construction and lining of the proposed pre-treatment facilities
  - Details of pipes and floor drainage conveying the effluent
  - Stormwater drainage plan
3. Nature of processes of the business attached **(not required for renewals)** ☐
4. Any other relevant supporting documents e.g. **(not required for renewals)** ☐
  - Environmental Impact Statement
  - Consultant's Report
  - EPA consideration / restrictions
  - Details of chemicals being used and SDS

The applicant should be aware that approval of this application does not constitute a guarantee of any future approval of a variation to the approval. This will be dependent on the available capacity of the sewerage system at that time and any future approval must not be assumed. However, alerting the Council to the applicant's future plans and proposals may assist the Council in planning future sewage management and / or infrastructure additions / modifications.

Signature of approval holder:

Position in company

Date



**Property Owner Details and Consent:**

The names and signatures of all owners should be shown in this section. (Written authority from the owner is required if a solicitor or agent is acting on behalf of the owner).

For application made on Crown land, whether leased or not, the owner's details must be signed by an officer of the Department of Lands who is authorised for these purposes, or Council's Authorised Officer if acting as custodian. (This must be signed prior to lodgement of an application)

If the property is owned by a Company, the application must be executed using the Company Seal or the appropriate director's signature. Any person signing on behalf of the Company must state the authority by which that person acts and print your name and position.

If signing on behalf of an Owners Corporation, signatures required are as follows:

1. where the proposed development is within the internal walls of the unit, the unit owner only
2. where the proposed development is in a courtyard or on common property,

Property Address:

Property Owner's Name

Telephone No. / Email

Postal Address

Signature of Property Owner/s

Owner's authorisation to making the application is mandatory as per Section 78 of the *Local Government Act 1993*

Please note that the owner of the property will be billed for water supply, sewerage and liquid trade waste services provided and it is the owner's responsibility to pay such fees and charges within the period specified. The owner may arrange to recover such fees and charges through the lease agreement between the owner and the occupier.

